
S1, S2 CONNECTORS




1 = – VOLTAGE
2 = + VOLTAGE
3 = SHIELD
4 = GROUND

mini fast.

FOUNDATION™ fieldbus

TERMINAL BLOCK PLUGS




1 = – VOLTAGE
2 = + VOLTAGE
3 = SHIELD
4 = GROUND


FOUNDATION™ fieldbus

SPECIFICATIONS

HOUSING MATERIAL/COLOR	NYLON 66 – 33% GLASS FILLED/BLACK
RECEPTACLE HOUSING MATERIAL/FINISH	STAINLESS STEEL/PASSIVATED
CONTACT CARRIERS/COLOR	TPU/BLACK
CONTACT MATERAIL/PLATING	BRASS/GOLD
COVER SCREW MATERIAL	STAINLESS STEEL
OPERATING VOLTAGE	300 V
OPERATING CURRENT	9.0 A PER CONDUCTOR
PROTECTION CLASS to DIN 40050	IP 67 – ONLY WHEN ALL RECEPTACLES ARE COVERED WITH PLUGS OR CONNECTED
OPERATING TEMPERATURE	–40°C to +70°C (–40°F to +158°F)

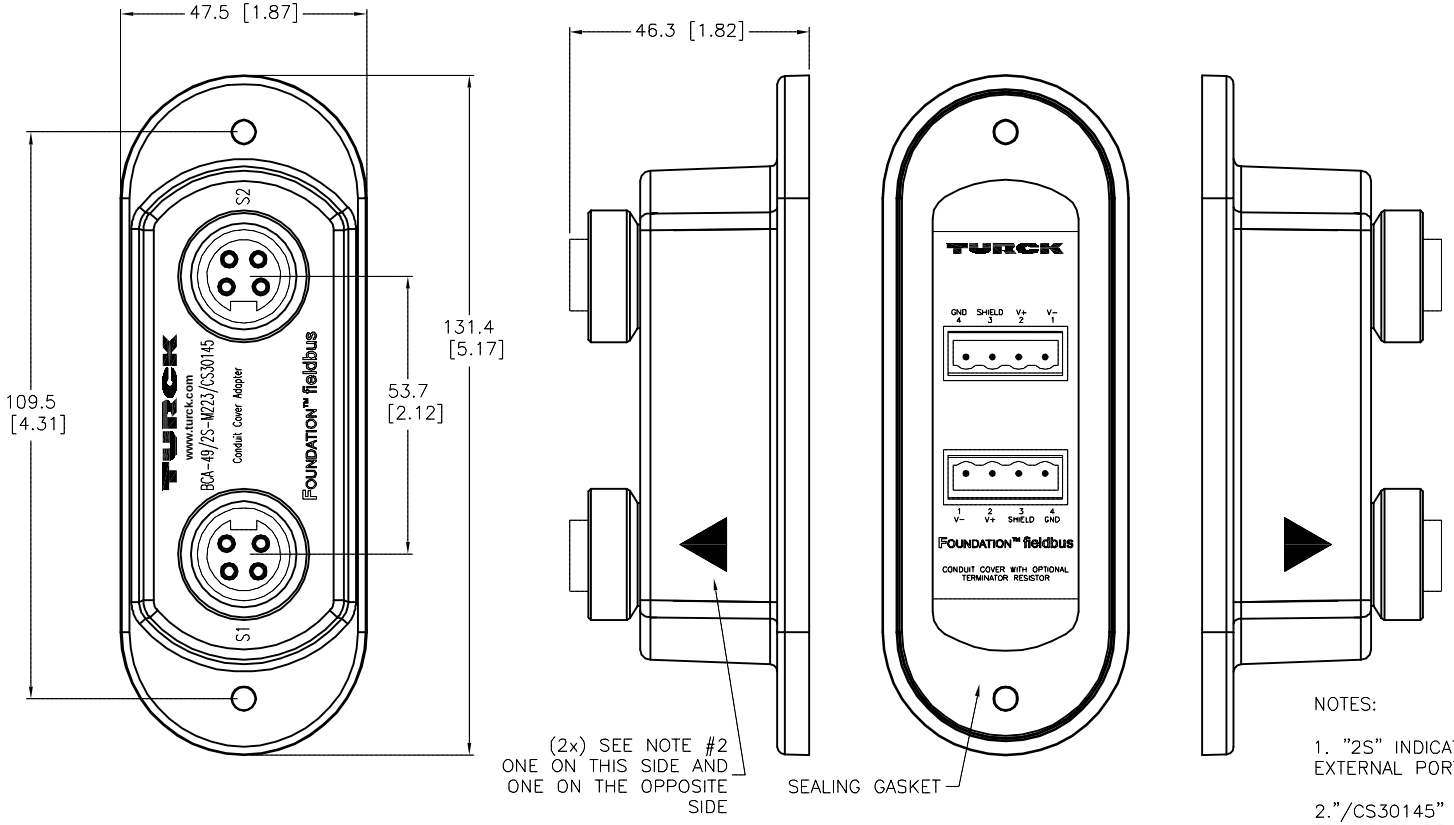

WIRING DIAGRAM

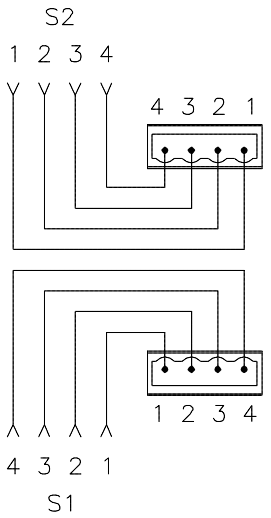


NOTES:

1. "2S" INDICATES SERIAL CONNECTIONS BETWEEN TERMINAL BLOCK AND EXTERNAL PORT.


2."/CS30145" DESIGNATES THIS PRODUCT HAS TWO YELLOW PAD PRINTED TRIANGLES PRINTED ON EACH SIDE OF THE BODY.

SOURCE DRAWING - FOR REFERENCE ONLY


COVER SCREWS INCLUDED



FORM 8 CONDUIT BODIES:
10–24 SCREWS



MARK 9 CONDUIT BODIES:
8–32 SCREWS



TERMINAL PLUGS INCLUDED

REV	DESCRIPTION	BY	DATE	ECO NO.
A	DRAWING RELEASE	RDS	04/26/18	

RELATED DOCUMENTS
1.
2.
3.
4.

MATERIAL

FINISH

3RD ANGLE PROJECTION

ALL DIMENSIONS DISPLAYED ON THIS DRAWING ARE FOR REFERENCE ONLY

CONTACT TURCK FOR MORE INFORMATION

THIS DRAWING IS CONFIDENTIAL AND THE PROPERTY OF TURCK INC. USE OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION IS PROHIBITED.

TURCK
3000 CAMPUS DRIVE
MINNEAPOLIS, MN 55441
1–800–544–7769
(763) 553–7300
(763) 553–0708 fax
www.turck.us

DRFT RDS | DATE 04/26/18
APVD M.F. | SCALE 1=1.5

UNIT OF MEASUREMENT
MILLIMETER [INCH]
DO NOT SCALE THIS DRAWING

DESCRIPTION
BCA–49/2S–M223/CS30145

IDENTIFICATION NO.
U2–32014

REV
A

FILE: U2–32014

SHEET 1 OF 1

Approved 04/26/2018, work order #162864 by M.F.