

TERMINAL BLOCK PLUG





1 = (V+)
2 = (SHIELD)
3 = (V–)

WIRING DIAGRAM

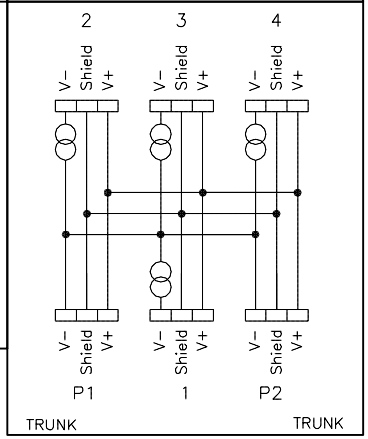

SPECIFICATIONS	
HOUSING MATERIAL/COLOR	EXTRUDED ALUMINUM/BLACK
END CAPS/COLOR	NYLON/BLACK
TERMINAL BLOCK MATERIAL/COLOR	NYLON/BLACK (1–4)
TERMINAL BLOCK MATERIAL/COLOR	NYLON/GREY (P1,P2)
OPERATING VOLTAGE	9–32 VDC
SHORT CIRCUIT PROTECTION	0.55 VDC @ 55mA, 0.20 VDC @ 20mA
OPEN CIRCUIT VOLTAGE	33 VDC
PROTECTION CLASS	IP 20
LED INDICATION, GREEN	POWER
LED INDICATION, RED	SHORT CIRCUIT INDICATION (1–4)
OPERATING TEMPERATURE	–40°C to +70°C (–40°F to +158°F)

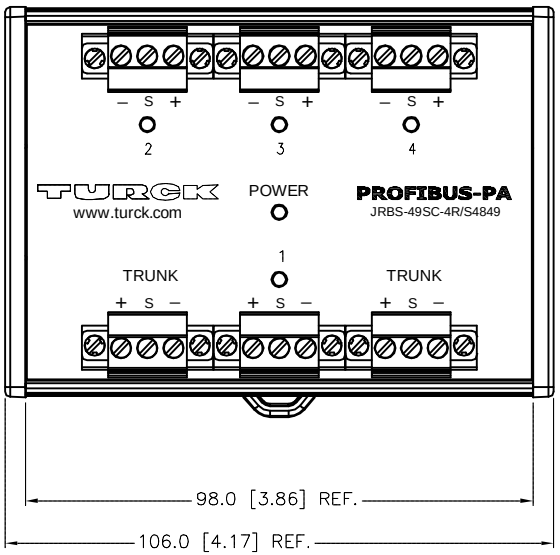

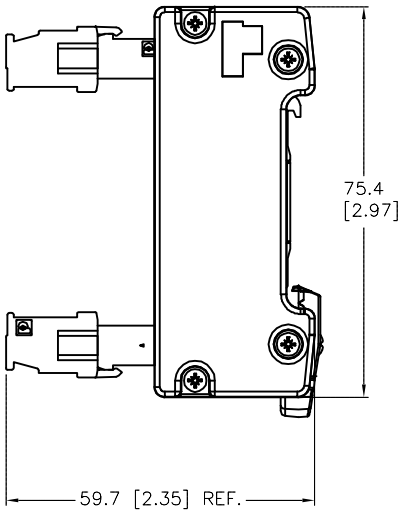

FM C US APPROVED

Class I,Div 2, Grps A,B,C, or D hazardous locations with nonincendive field wiring connections to Class I, Div 2, Grps C or D when installed per Turck Control Drawing Ni-2.410 available at www.turck.com/fmcd
Ta = 70°C Supply Rating 30V/1A T4

NOTES:

1. "/S4849" DESIGNATES NEW LABEL TO REMOVE FOUNDATION FIELDBUS LOGO. UNIT TO BE USED FOR PROFIBUS–PA.

SOURCE DRAWING - FOR REFERENCE ONLY

REV	DESCRIPTION	BY	DATE	ECO NO.
B	UPDATE END CAPS PER ECO	KMY	05/27/14	45028

RELATED DOCUMENTS
1.
2.
3.
4.

MATERIAL

FINISH

3RD ANGLE PROJECTION

ALL DIMENSIONS DISPLAYED ON THIS DRAWING ARE FOR REFERENCE ONLY

CONTACT TURCK FOR MORE INFORMATION

THIS DRAWING IS CONFIDENTIAL AND THE PROPERTY OF TURCK INC. USE OF THIS DOCUMENT WITHOUT WRITTEN PERMISSION IS PROHIBITED.

TURCK INC
High Technology Sensors and Automation Controls
3000 CAMPUS DRIVE
MINNEAPOLIS, MN 55441
1–800–544–7769
(763) 553–7300
(763) 553–0708 fax
turck.com

DRFT RDS | DATE 01/03/12
APVD C.V. | SCALE 1=1.5

UNIT OF MEASUREMENT
MILLIMETER [INCH]
DO NOT SCALE THIS DRAWING

DESCRIPTION
JRBS–49SC–4R/S4849

IDENTIFICATION NO. U3–10877 | REV B

FILE: U3–10877 | SHEET 1 OF 1